

HIOKI

INSULATION / WITHSTANDING Test Instrument series 3153/3159/ST5520



3153 CE



3159 Not CE Marked



ST5520 CE

This electrical safety test instrument series is designed for insulation resistance and voltage withstand testing of electrical devices and components according to various safety standards. A multitude of automation and labor-saving features are provided to ensure effective testing for a wide variety of requirements and test conditions. Select the most appropriate model for your applications.

AUTOMATIC INSULATION / WITHSTANDING HITESTER
3153
INSULATION / WITHSTANDING HITESTER 3159
INSULATION TESTER ST5520

3 year
Guarantee

Model 3153

Automatic Insulation Voltage Withstand Testing

Voltage Control from a PC

Full Remote Control

All test parameters can be controlled by RS-232C or GP-IB, including test voltage, cut-off current, resistance threshold and timer durations. Start-stop control can be provided with the 9613 single hand remote control or 9614 two-hand remote control.

Standards-Based Testing


Comparator/Timer

Includes built-in pass-fail comparator and timer functions for easy compliance testing to various safety standards such as those for Electrical Appliance Safety Regulations.

Settable Ramp Up/Down Test Voltage Timing

Ramp Timer Functions


Raising and lowering of test voltage can be set for voltage withstand testing.

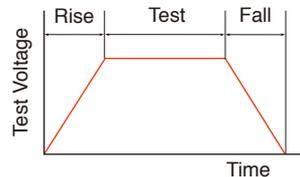

Test Status Read/Write

Program Function

Test conditions can be stored and recalled to support complete automation by sequencer. Up to 32 files can be stored with up to 50 steps per file.



Analog Voltmeter

The test voltage can be verified not only on the digital display but also on the analog meter.

Danger Lamp


The warning light flashes during testing and whenever high voltage is present at the terminals.

External Switch

Start/stop may be controlled with the 9613 or the 9614 .
(The 9613 and 9614 are options.)

Fluorescent Display Tube

The display uses a bright, easy-to-read fluorescent tube.

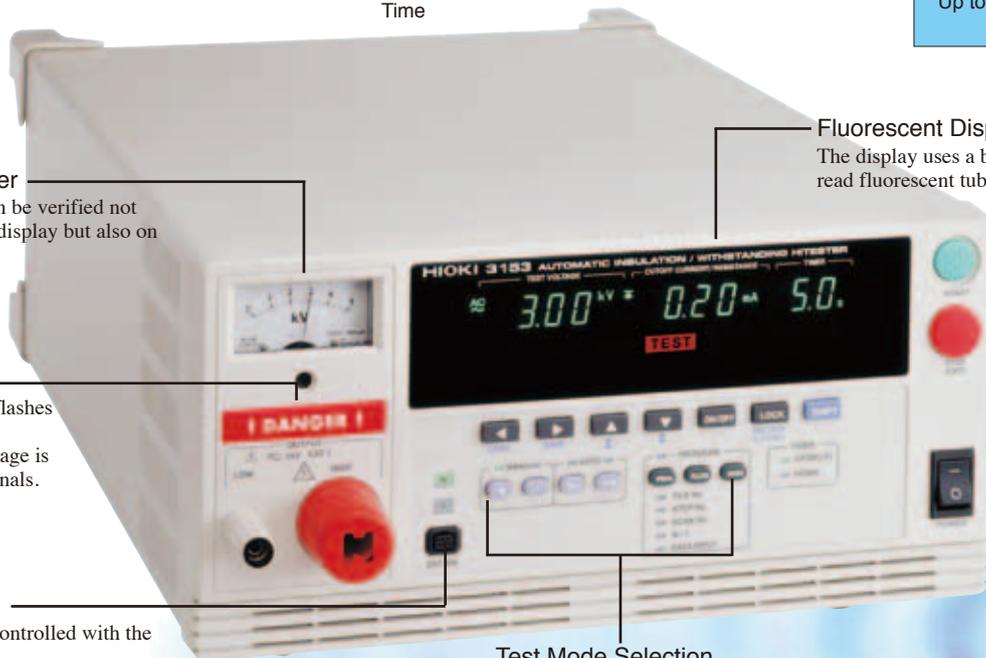

Test Mode Selection

Three test modes are selectable:

1. Manual test modes: ACW, DCW, I
2. Automatic test modes: W → I, I → W
3. Programmed test modes: testing by preprogrammed functions.

● Automation Support

Automation features include programmable testing modes, EXT I/O, RS-232C, GP-IB, connection scanning and various data management functions.

● Save 10 Sets of Test Conditions

Store up to 10 sets of test conditions for voltage withstand and insulation resistance modes, so you can quickly switch among the test conditions. (Save/Load)

● Interlock Protect Function

To ensure safety during automatic testing, test output can be interrupted and testing inhibited by input signals from automatic sensing devices.

● Auto Discharge Feature

Any charge on the object under test is discharged by the test instrument, so there is no residual charge after testing. (DC voltage withstand, insulation resistance tests)

● Zero-V Switching

Test voltage on/off switching can be forced to occur only at sine wave zero-crossings. (AC voltage withstand testing)

● PWM Switching Technique

Enhanced accuracy is obtained by preventing variations in supply voltage from affecting test voltage.

Wide Range of Functions for Various Conditions

1. Pass Hold Function (0: No Hold, 1: Hold)

The pass state is held when it is activated. This is convenient for verifying the decision value.

2. Fail Hold Function (0: No Hold, 1: Hold)

The fail state is held when it is activated. This is convenient for temporarily stopping the test process.

3. Hold State (0: No Hold, 1: Hold)

This saves the state when the Stop key is pressed during a test to unconditionally end the test.

4. Momentary Out (0: Disabled, 1: Enabled)

This function outputs a voltage only when the Start key is being pressed. The Start key is effective both for EXT SW and external I/O.

5. Double Action (0: Disabled, 1: Enabled)

This function allows testing to start only if the Start key is pressed within a half second after the Stop key.

6. Fail Mode (0: Disabled, 1: Enabled)

This function allows the Hold state to be released only by the Stop key on the instrument panel.

7. "START" Interface Command (0: Disabled, 1: Enabled)

This specifies whether the "START" command is enabled.

8. Interlock Function (0: Disabled, 1: Enabled)

This specifies whether the interlock terminal for external I/O is enabled.


9. Maximum Output Voltage

Sets the upper limit of the test voltage.

10. Insulation Resistance Measurement Range

(0: Fixed Range, 1: Automatic Range)

This specifies whether the measurement range for insulation resistance testing should be fixed or automatically determined.

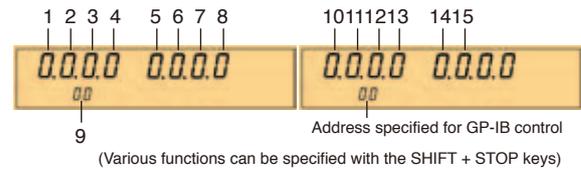

11. Insulation Resistance Test End Mode

0: Test for the specified time

1: Stop when "pass" is detected

2: Stop when "fail" is detected

This specifies the method of ending insulation resistance tests.

12. Ramp Time Setting

0: No judgment during ramp-up

1: Judgment during ramp-up

This specifies whether the judgment is enabled during ramp-up. Valid only during voltage withstand testing.

13. PC Interface

0: RS-232C (PC, 9600 bps)

1: RS-232C (PC, 19200 bps)

2: GP-IB

This specifies the type of PC interface to use.

14. Electrical Discharge Function

(0: Disabled, 1: Enabled)

This specifies whether the electrical discharge function is enabled at the end of testing.

15. Test Signal Output

0: ON also when TEST indicator is flashing

1: OFF when TEST indicator is flashing

2: ON only when TEST indicator is flashing

(excluding ramp down time)

This specifies whether the TEST signal of the external I/O should be output when the TEST indicator is flashing.

Enhanced System Measurements

Maximum 32-Channel Multi-Point Testing

Model 3930 HIGH VOLTAGE SCANNER

Combine Model 3153 with the 3930 HIGH VOLTAGE SCANNER to perform insulation withstand testing easily. Single-end inputs test up to 8 points (between any 4 points) per instrument, and can connect up to 4 instruments together.

Model 3930 Specifications

| | |
|----------------------|---|
| No. of Channels | Multi-Mode: 4 High-Low channels |
| | Single-End Mode: 8 High-Common channels |
| Operating Voltage | 5 kV AC, 7 kV DC |
| Action/Recovery Time | 6 ms or less |
| Supply Voltage | 24 V DC $\pm 5\%$ (at control signal input connector) |
| Size & Mass | Approx. 320(W) \times 90(H) \times 250(D) mm, 3 kg. |

Simultaneous Protective Ground Continuity Testing

Safety Inspection System

Combine Model 3153 with the 3157-01 AC GROUNDING HITESTER and a general-purpose sequencer for a simple safety test inspection system that includes protective ground continuity and insulation withstand testing.



Model 3157-01
AC GROUNDING HITESTER

Settable current ranges:
3.0 to 31 A AC

Max. output power:
130VA

Resistance
measurement range:
0 to 1,800 Ω

A Full Line-up of Models to Suit Various Needs

Model 3153

AUTOMATIC INSULATION / WITHSTANDING HITESTER




3 Year Guarantee

Voltage Withstand Testing
 AC: 0.20 to 5.00 kV, 500 VA
 DC: 0.20 to 5.00 kV, 50 VA
 0.01 to 100.0 mA

Insulation Testing
 DC: 50 to 1200 V
 0.10 to 9999 MΩ

- Insulation and AC/DC continuous voltage withstand testing
- Safety standards compliance testing
- Stores up to 10 sets of test conditions (10 each for insulation and voltage withstand)
- Zero-V Switching (voltage withstand testing)
- Electrical Discharge function (DC voltage withstand, insulation testing)
- Automated testing support
- Interlock Protect function
- Remote controllable

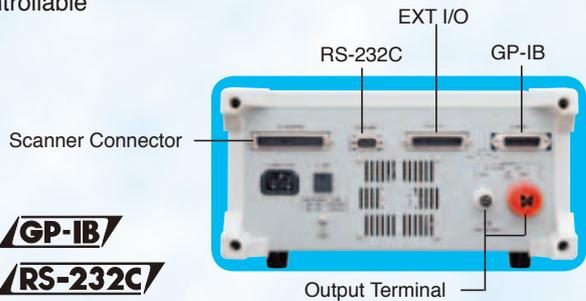

GP-IB
RS-232C

Model 3159

INSULATION / WITHSTANDING HITESTER




3 Year Guarantee

Voltage Withstand Testing
 AC: 0 to 2.5 kV/5.0 kV, 500 VA
 0.01 to 120.0 mA

Insulation Testing
 DC: 500/1000 V
 0.5 to 2000 MΩ

- Insulation and voltage withstand testing
- Safety standards compliance testing
- Stores up to 10 sets of test conditions (10 each for insulation and voltage withstand)
- Voltage comparator functions (voltage withstand testing)
- Zero-V Switching (voltage withstand testing)
- Electrical Discharge function (insulation testing)
- Automated testing support
- Interlock Protect function
- Remote controllable
- Not CE marked

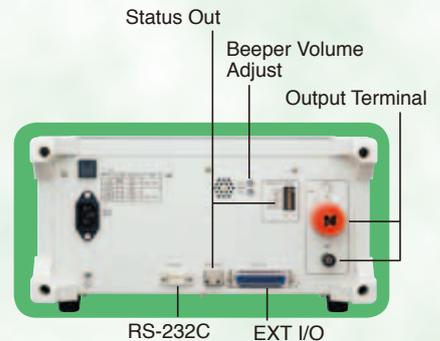

RS-232C


Model 3158

AC WITHSTANDING VOLTAGE HITESTER



Voltage Withstand Testing
 AC: 0 to 2.5 kV/5.0 kV, 500 VA
 0.01 to 120.0 mA

- Safety standards compliance testing
- Stores up to 20 sets of test conditions
- Voltage comparator functions
- Zero-V Switching
- Electrical Discharge function
- Automated testing support
- Interlock Protect function
- Selectable remote controls

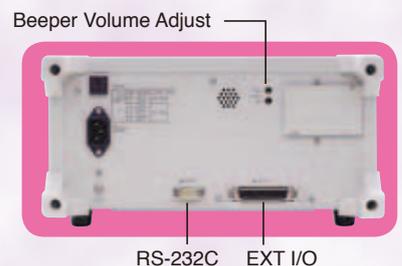

RS-232C

EXT I/O Output Signals

External control can be provided by various signals (signal lines have photocoupler isolation)

| Pin | I/O | Signal | Function |
|-------|-----|----------|---|
| 1 | OUT | READY | LO when in "ready state" |
| 2 | OUT | L-FAIL | LO when in "fail state" for the lower bound |
| 3 | OUT | U-FAIL | LO when in "fail state" for the upper bound |
| 4 | OUT | PASS | LO when in "pass state" |
| 5 | OUT | TEST | LO when in "test state" |
| 6 | OUT | H.V.ON | LO when voltage is present at the output terminals |
| 7 | IN | EXT-E | When LO, external I/O input signals are enabled |
| 8 | IN | START | When LO, it functions as a "Start" key |
| 9 | IN | STOP | When LO, it functions as a "Stop" key |
| 10 | IN | INT.LOCK | Interlock engaged when open |
| 11 | OUT | W-MODE | LO during voltage withstand testing |
| 12 | OUT | I-MODE | LO during insulation testing |
| 13 | OUT | W-FAIL | LO when in "fail state" for voltage withstand testing |
| 14 | OUT | I-FAIL | LO when in "fail state" for insulation testing |
| 15-16 | IN | ISO.GND | Ground inputs for external devices |

| Pin | I/O | Signal | Function |
|-------|-----|----------|---------------------------------------|
| 17-18 | IN | EXT.COM | Common terminals for external devices |
| 19 | OUT | STEP-END | LO when at the end of a step |
| 20 | OUT | FILE-END | LO when at the end of a file |
| 21 | IN | FILE-E | LO when FILE 0 to 4 is in use |
| 22 | IN | FILE-0 | File selection |
| 23 | IN | FILE-1 | File selection |
| 24 | IN | FILE-2 | File selection |
| 25 | IN | FILE-3 | File selection |
| 26 | IN | FILE-4 | File selection |
| 33-34 | OUT | ISO.DCV | Internal power 5V DC (60 mA) |
| 35-36 | IN | EXT.DCV | External power supply (5 to 30V DC) |

Various Function Settings

1. PASS Hold function
2. FAIL Hold function
3. Hold function
4. Momentary out
5. Double actions
6. FAIL mode
7. "START" interface command
8. Interlock function
9. Maximum Output Voltage
10. Insulation Resistance measurement range
11. Insulation Resistance Test End mode
12. Ramp Timer setting
13. PC Interface
14. Electrical Discharge function
15. TEST signal output

Status Out

When the output conditions set by the DIP switches are satisfied (OR condition), output is provided at relay contacts.

| | |
|--------------|---------------------------|
| 1. H.V.ON | Output voltage generation |
| 2. TEST | Testing in progress |
| 3. PASS | Passed |
| 4. FAIL | Failed |
| 5. INT.LOCK | Interlocked |
| 6. READY | Ready |
| 7. EXT.CONT. | Under external control |
| 8. POWER.ON | Powers the 3159 on |

| Pin | I/O | Signal | Function |
|-------|-----|----------|---|
| 1 | OUT | READY | LO when in "ready state" |
| 2 | OUT | L-FAIL | LO when in "fail state" for the lower bound |
| 3 | OUT | U-FAIL | LO when in "fail state" for the upper bound |
| 4 | OUT | PASS | LO when in "pass state" |
| 5 | OUT | TEST | LO when in "test state" |
| 6 | OUT | H.V.ON | LO when voltage is present at the output terminals |
| 7 | IN | EXT-E | When LO, external I/O input signals are enabled |
| 8 | IN | START | When LO, it functions as a "Start" key |
| 9 | IN | STOP | When LO, it functions as a "Stop" key |
| 10 | IN | INT.LOCK | Interlock engaged when open |
| 11 | OUT | W-MODE | LO during voltage withstand testing |
| 12 | OUT | I-MODE | LO during insulation testing |
| 13 | OUT | W-FAIL | LO when in "fail state" for voltage withstand testing |
| 14 | OUT | I-FAIL | LO when in "fail state" for insulation testing |
| 15-18 | IN | ISO.COM | Ground inputs for external devices |
| 33-36 | OUT | ISO.DCV | Internal power 15V DC (100 mA) |

1. PASS Hold function
2. FAIL Hold function
3. Hold function
4. Momentary out
5. Double actions
6. FAIL mode
7. "START" RS command
8. Interlock function
9. Voltage Comparator position
10. Insulation Resistance measurement range
11. Insulation Resistance Test End mode

| Pin | I/O | Signal | Function |
|-------|-----|----------|--|
| 1 | OUT | READY | LO when in "ready state" |
| 2 | OUT | L-FAIL | LO when in "fail state" for the lower bound |
| 3 | OUT | U-FAIL | LO when in "fail state" for the upper bound |
| 4 | OUT | PASS | LO when in "pass state" |
| 5 | OUT | TEST | LO when in "test state" |
| 6 | OUT | H.V.ON | LO when voltage is present at the output terminals |
| 7 | IN | EXT-E | When LO, external I/O input signals are enabled |
| 8 | IN | START | When LO, it functions as a "Start" key |
| 9 | IN | STOP | When LO, it functions as a "Stop" key |
| 10 | IN | INT.LOCK | Interlock engaged when open |
| 15-18 | IN | ISO.COM | Ground inputs for external devices |
| 33-36 | OUT | ISO.DCV | Internal power 15V DC (100 mA) |

1. PASS Hold function
2. FAIL Hold function
3. Hold function
4. Momentary out
5. Double actions
6. FAIL mode
7. "START" RS command
8. Interlock function
9. Voltage Comparator position

Specifications Accuracy guaranteed for 1 year, Post-adjustment accuracy guaranteed for 1 year

■ Voltage Withstand Testing

| | Model 3153 AUTOMATIC INSULATION / WITHSTANDING HITESTER | | Model 3159 INSULATION / WITHSTANDING HITESTER | Model 3158 AC WITHSTANDING VOLTAGE HITESTER |
|-------------------------------------|---|--|--|---|
| | AC | DC | AC | |
| Output voltage | 0.20 to 5.00 kV | 0.20 to 5.00 kV | Two ranges: AC 0 to 2.5 or 5.0 kV | |
| Voltage output method | PWM switching method (zero-switching) | PWM switching method | Zero-switching | |
| Transformer capacity | 500 VA (rated 30 minutes) | ... | 500 VA (rated 30 minutes) | |
| Output capacity | ... | 50 VA (continuous) | ... | |
| Voltage adjustment method | Digital setting (0.01 kV setting resolution) | | Manual adjustment | |
| Output voltage accuracy | ±1.5% of setting voltage ±2 dgt. | | ... | |
| Voltage change rate | ±7% or less (max. 5 kV at 100 mA → unloaded: with resistive load)*2 | ±16% or less (max. 5 kV at 10 mA → unloaded: with resistive load)*2 | ... | |
| Voltage waveform | Sine wave (5% or less distortion, unloaded) | ... | Power waveform | |
| Voltage frequency | 50 or 60 Hz ±0.2% | ... | Power synchronization | |
| Output ripple voltage | ... | 6% of output voltage or less (at 5 kV DC, 10 mA, resistive load) | ... | |
| Output current | 100 mA *1 | 10 mA (continuous) | ... | |
| Voltmeter | Average rectified effective value display | Average display | Average rectified effective value display | |
| | Digital: 0.00 to 5.00 kV (full scale) Accuracy: ±1.5% f.s. Analog: 0 to 5 kV (full scale) Accuracy: ±5% f.s. | | Digital: 0.00 to 5.00 kV (full scale) Accuracy: ±1.5% f.s. Analog: 0 to 5 kV (full scale) Accuracy: ±5% f.s.a | |
| Current measurement range | 0.01 to 100.0 mA | 0.01 to 10.0 mA | 0.01 to 120.0 mA | |
| Indicated value range | 10 or 100 mA | 10 mA | 2, 8, 32 or 120 mA | |
| Measurement resolution | 0.00 to 10.00 or 0.01 mA (10-mA range) 10.1 to 100.0 or 0.1 mA (100-mA range, AC only) | | 0.01 mA (2- or 8-mA range), 0.1 mA (32-mA range), 1 mA (120-mA range) | |
| Current measurement accuracy | ± (2% rdg. + 5 dgt.) common to each range *3 | | ± (3% f.s. + 20 μA) for all ranges (at 5% power distortion or less) | |

*1. Time vs. Output Voltage (at 23°C ambient)

| Current Measurement Range | Max. Test Time | Standby Time |
|---------------------------|----------------|--------------|
| 1 ≤ 60 mA | continuous | none |
| 60 mA < 1 ≤ 100 mA | 15 minutes | 15 minutes |

*2. Unloaded = 40 MΩ load (instrument input impedance)

*3. Plus scanner accuracy, when used.

■ Insulation Resistance Testing

| | Model 3153 | Model 3159 | Model 3158 |
|-----------------------------------|---|--|-------------------|
| Test voltage | Output voltage: Positive polarity 50 to 1200V DC Voltage adjustment method: Digital setting (1V resolution) Output voltage accuracy: ±1.5% ±2 dgt. of setting level | Rated voltage: 500 or 1000V DC Unloaded voltage: 1 to 1.2 times rated voltage | ... |
| Rated measurement current | 1 mA | 1 to 1.2 mA | ... |
| Short-circuit current | 200 mA or less | 4 to 5 mA (500V) 2 to 3 mA (1000V) | ... |
| Voltmeter | Average display Digital: 0 to 1200V DC (full scale) Accuracy: ±1.5% rdg. ±2 dgt. Analog: 0 to 1200V DC Accuracy: ±5% f.s. (5 kV full scale) | Average display Digital: 0 to 1200V DC (f.s.) | ... |
| | | Analog: not applicable | |
| Measurement range/accuracy | 0.100 to 1.049 MΩ 1.05 to 10.49 MΩ*1 10.5 to 104.9 MΩ*1 105 to 9999 MΩ*1 Fundamental accuracy: ±4% rdg.*2 | 0.5 to 999 MΩ (500V)/±4% rdg. 1 to 999 MΩ (1000V)/±4% rdg. 1000 to 2000 MΩ /±8% rdg. | ... |

*1. Measurement range changes according to test voltage.

*2. Plus scanner accuracy, when used.

* Accuracy guaranteed for 1 year, Post-adjustment accuracy guaranteed for 1 year

Decision Function

| | Model 3153 | Model 3159 | Model 3158 |
|---------------------------------|---|--|------------|
| Decision method | Window comparison method (digital specification) | | |
| Decision results | UPPER-FAIL: Measured current (insulation resistance value) exceeded the specified upper bound. PASS: Measured current (insulation resistance value) was between the specified upper and lower bounds during the specified time elapsed LOWER-FAIL: Measured current (insulation resistance value) was less than the specified lower bound (Note: Model 3158 has no insulation resistance function) | | |
| Decision processing | For each decision result, output the display portion, the beeper sound, and EXT I/O signal | | |
| Specification ranges | Voltage withstand testing: ACV: 0.1 to 100 mA (upper bound) / 0.1 to 99 mA (lower bound) DCV: 0.1 to 10 mA (upper bound) / 0.1 to 9.9 mA (lower bound) Insulation testing: 0.10 to 9999 MΩ (same upper/lower bounds) | Voltage withstand testing: 0.1 to 120 mA (upper bound) / 0.1 to 119 mA (lower bound) Insulation testing (Model 3159 only): 0.2 to 2000 MΩ (same upper/lower bounds) | |
| Specification resolution | Voltage withstand testing: 0.1 mA (0.1 to 9.9 mA), 1 mA (10 to 100 mA) Insulation testing: 0.01 MΩ (0.10 to 9.99 MΩ), 0.1 MΩ (10.0 to 99.9 MΩ), 1 MΩ (100 to 9999 MΩ) | Voltage withstand testing: 0.1 mA (0.1 to 9.9 mA), 1 mA (10 to 120 mA) Insulation testing (Model 3159 only): 0.01 MΩ (0.2 to 2 MΩ), 0.1 MΩ (2.1 to 20 MΩ), 1 MΩ (21 to 200 MΩ), 10 MΩ (210 to 2000 MΩ) | |

Timers

| | Model 3153 | Model 3159 | Model 3158 |
|--|--|---|------------|
| Testing timer | Specification range: 0.3 to 999 s Specification resolution: 0.1 s (0.3 to 99.9 s), 1 s (100 to 999 s) Accuracy: ±0.5% of specified value | Specification range: 0.5 to 999 s Specification resolution/accuracy: 0.1 s (0.5 to 99.9 s), ±50 ms; 1 s (100 to 999 s) ±0.5 s | |
| | Action: (when ON is specified) after starting, the countdown from the specified time is displayed. (when OFF is specified) displays the elapsed time from starting | | |
| Ramp timer (withstand test time) | Specification range: 0.1 to 99.9 s ramp-up and -down specified separately Specification resolution/accuracy: 0.1 s, ±0.5% of specified value | ... | |
| Delay timer (insulation resistance test time) | Specification range: 0.1 to 99.9 s Specification resolution/accuracy: 0.1 s, ±0.5% of specified value Action: specify a delay time after testing is set to begin to inhibit decisions during that time | Non-deterministic interval: 0.5 s (Mask time until determination begins during insulation resistance testing) | ... |

Interfaces

| | Model 3153 | Model 3159 | Model 3158 |
|----------------|--|---|------------|
| EXT I/O | Open-collector outputs, active low, max. 30V DC loaded voltage, all signal lines photocoupler-isolated | | |
| EXT SW | START, STOP, SW.EN (panel terminal switch enabled), connection point inputs | | |
| RS-232C | Start-stop synchronization, full duplex, 9600 or 19200 bps | Start-stop synchronization, full duplex, 9600 bps | |
| GP-IB | IEEE 488.2 (1987) compliant | ... | |

General Specifications

| | Model 3153 | Model 3159 | Model 3158 |
|---|---|--|---|
| Display | Fluorescent display tube (digital display), analog meter | | |
| Monitor functions | Output voltage, detected current, measured resistance | | Output voltage, detected current |
| Monitor period | 2 times per second minimum | | |
| Operating temperature range | 0 to 40 °C, 80% RH maximum (non-condensating) | | |
| Storage temperature range | -10 to 50 °C, 90% RH maximum (non-condensating) | | |
| Temperature and humidity range for guaranteed accuracy | 23 ± 5 °C, 80% RH maximum (non-condensating) (after 10-min. warm-up for 3153, or 5-min. warm-up for 3158 and 3159) | | |
| Operating environment | Indoors, up to 2000m ASL | | |
| Power supply voltage | 100 to 240V AC (installed fuse depends on actual voltage, so specify supply voltage when ordering) 100 to 120V AC: installed fuse 250V T10AL 200 to 240V AC: installed fuse 250V T5AL | 100V AC (3159)...for Japan only 220V AC (3159-02) 120V AC (3159-01) ...discontinued 230V AC (3159-03) ...discontinued 240V AC (3159-04) ...discontinued | 100V AC (3158)...for Japan only 120V AC (3158-01) ...discontinued 220V AC (3158-02) ...discontinued 230V AC (3158-04) ...discontinued 240V AC (3158-05) ...discontinued |
| Power supply frequency | 50 or 60 Hz | | |
| Max. power consumption | 1000 VA | 800 VA | |
| Dimensions | Approx. 320 (W) × 155 (H) × 480 (D) mm | Approx. 320 (W) × 155 (H) × 330 (D) mm | Approx. 320 (W) × 155 (H) × 263 (D) mm |
| Mass | Approx. 18 kg | Approx. 18 kg (3159), 20.5 kg (3159-01), 21.5 kg (3159-02/-03/-04) | Approx. 16 kg (3158-01), 18 kg (3158-03/-04/-05) |
| Supplied accessories | 9615 H.V. TEST LEADS (high voltage side and return, one each), POWER CORD, EXTRA FUSE | | |
| Options | 9613 REMOTE CONTROL BOX (SINGLE), 9614 REMOTE CONTROL BOX (DUAL), 9637 RS-232C CABLE (9-pin Dsub to 9-pin Dsub), 9638 RS-232C CABLE (9-pin Dsub to 25-pin Dsub), 9267 SAFETY TEST DATA MANAGEMENT SOFTWARE 3930 HIGH VOLTAGE SCANNER 9151-02 GP-IB CONNECTOR CABLE (2m) 9151-04 GP-IB CONNECTOR CABLE (4m) | 9616 WARNING LAMP | |

Model ST5520 INSULATION TESTER

- Rapidly assess in as fast as 50 ms
- Quick discharge of residual voltage
- Freely configurable test voltage
 - Set from 25 V to 1000 V, 1 V resolution --
- Contact check function
 - Prevents errors due to poor contact --
- Short-circuit check function
 - Stops potential defects from reaching the market --



3 year
Guarantee

Basic Specifications

| | |
|---|---|
| Testing voltage/ measurement ranges (Auto / Manual) | 25 V ≤ V < 100 V (2.000/20.00/200.0 MΩ), 100 V ≤ V < 500 V (2.000/20.00/200.0/2000 MΩ), 500 V ≤ V ≤ 1000 V (2.000/20.00/200.0/4000/9990 MΩ) |
| Basic accuracy | ±2 % rdg. ±5 dgt. 25 V ≤ V < 100 V [0 to 20 MΩ] 100 V ≤ V < 500 V [0 to 20 MΩ] 500 V ≤ V ≤ 1000 V [0 to 200 MΩ] |
| Measurement speed | Fast: 30 ms/time, Slow: 500 ms/time (selectable) |
| Memory capacity | up to 10 items (can be saved/loaded) |

Accuracy guaranteed for 1 year, Post-adjustment accuracy guaranteed for 1 year

3153 AUTOMATIC INSULATION / WITHSTANDING HITESTER

Options

- 3930 HIGH VOLTAGE SCANNER
- 9613 REMOTE CONTROL BOX (SINGLE)
- 9614 REMOTE CONTROL BOX (DUAL)
- 9151-02 GP-IB CONNECTOR CABLE (2m)
- 9637 RS-232C CABLE (1.8 m) (9pin-9pin/Cross)
- 9638 RS-232C CABLE (1.8 m) (9pin-25pin/Cross)
- 9267 SAFETY TEST DATA MANAGEMENT SOFTWARE

3159 **for Japan only** / WITHSTANDING HITESTER (100V AC)

3159-01 **Discontinued** / WITHSTANDING HITESTER (120V AC)

3159-02 **Discontinued** / WITHSTANDING HITESTER (220V AC)

3159-03 **Discontinued** / WITHSTANDING HITESTER (230V AC)

Options

- 9613 REMOTE CONTROL BOX (SINGLE)
- 9614 REMOTE CONTROL BOX (DUAL)
- 9616 WARNING LAMP
- 9637 RS-232C CABLE (1.8 m) (9pin-9pin/Cross)
- 9638 RS-232C CABLE (1.8 m) (9pin-25pin/Cross)
- 9267 SAFETY TEST DATA MANAGEMENT SOFTWARE

3158 **for Japan only** / WITHSTANDING VOLTAGE HITESTER (100V AC)

3158-01 **Discontinued** / WITHSTANDING VOLTAGE HITESTER (120V AC)

3158-03 **Discontinued** / WITHSTANDING VOLTAGE HITESTER (220V AC)

3158-04 **Discontinued** / WITHSTANDING VOLTAGE HITESTER (230V AC)

3158-05 **Discontinued** / WITHSTANDING VOLTAGE HITESTER (240V AC)

Options

- 9613 REMOTE CONTROL BOX (SINGLE)
- 9614 REMOTE CONTROL BOX (DUAL)
- 9637 RS-232C CABLE (1.8 m) (9pin-9pin/Cross)
- 9638 RS-232C CABLE (1.8 m) (9pin-25pin/Cross)
- 9267 SAFETY TEST DATA MANAGEMENT SOFTWARE



9613
REMOTE CONTROL BOX (SINGLE)



9614
REMOTE CONTROL BOX (DUAL)



9615
H.V. TEST LEADS



Discontinued
9616
WARNING LAMP
(100V AC, 0.1A)

When using Model 9616 with Models 3153 or 3158, please contact HIOKI for specific details.

3157-01 AC GROUNDING HITESTER

ST5520 INSULATION TESTER

ST5520-01 INSULATION TESTER (with BCD output)

Note: Company names and Product names appearing in this catalog are trademarks or registered trademarks of various companies.

HIOKI

HIOKI E. E. CORPORATION

HEADQUARTERS
81 Koizumi
Ueda, Nagano 386-1192 Japan
www.hioki.com

HIOKI USA CORPORATION
TEL +1-609-409-9109 FAX +1-609-409-9108
hioki@hiokiusa.com / www.hiokiusa.com

HIOKI (Shanghai) SALES & TRADING CO., LTD.
TEL +86-21-6391-0090/0092 FAX +86-21-6391-0360
info@hioki.com.cn / www.hioki.cn

HIOKI SINGAPORE PTE. LTD.
TEL +65-6634-7677 FAX +65-6634-7477
info-sg@hioki.com.sg / www.hioki.com.sg

HIOKI KOREA CO., LTD.
TEL +82-2-2183-8847 FAX +82-2-2183-3360
info-kr@hioki.co.jp / www.hiokikorea.com

HIOKI EUROPE GmbH
TEL +49-6173-31856-0 FAX +49-6173-31856-25
hioki@hioki.eu / www.hioki.com

DISTRIBUTED BY